

K-MART

Electrical Room

Generator

BLD-05094 - Main Building - Bldg 01

-  Fire Extinguisher
-  Fire Alarm Pull Boxes
-  First Aid
-  Elevator
-  Stairs
-  Exits
- Emergency #911
- Alarm Signal = Chime & Light Strobe
- 
- In Case of Fire Use Stairway For Exit
- DO NOT USE ELEVATORS**

Windsor Terrace Of Westlake Village Facility No. 27753


# Windsor Terrace Of Westlake Village Facility No. 27753

-  Fire Alarm Pull Boxes
-  First Aid
-  Elevator
-  Stairs
-  Exits
-  Gas Shut-Off
-  Electrical Panel
-  Fire Locator

X Main Water Springs  
 ● Water Marsh

Code Words:  
 Fire - Dr. Firestone  
 Disaster - Triage  
 PR - Code Blue

Fence

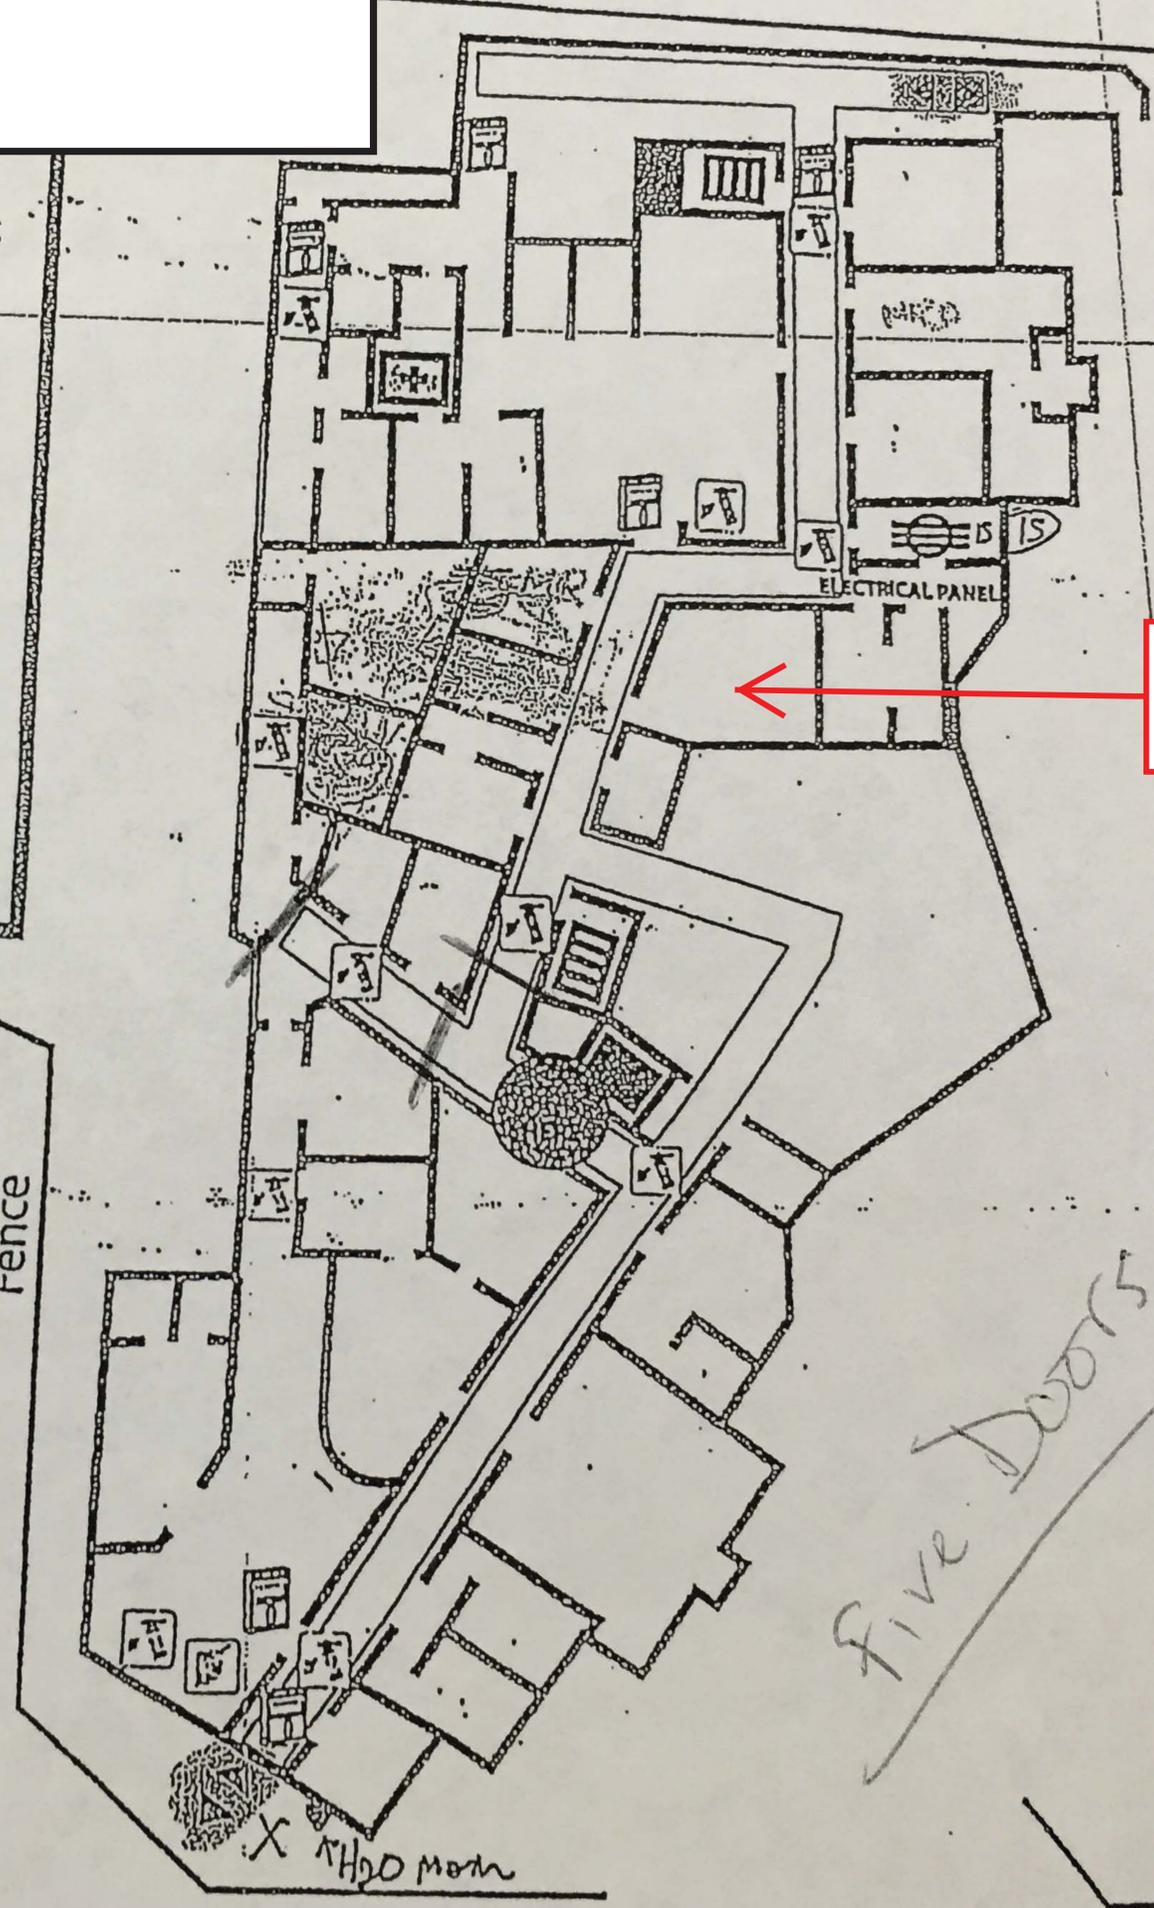

BLD-05094 - Main Building - Bldg 01

Five Doors

 GAS SHUT-OFF

X Main Water Springs